


# 110.26(A)(1) Clearances around Electrical Equipment

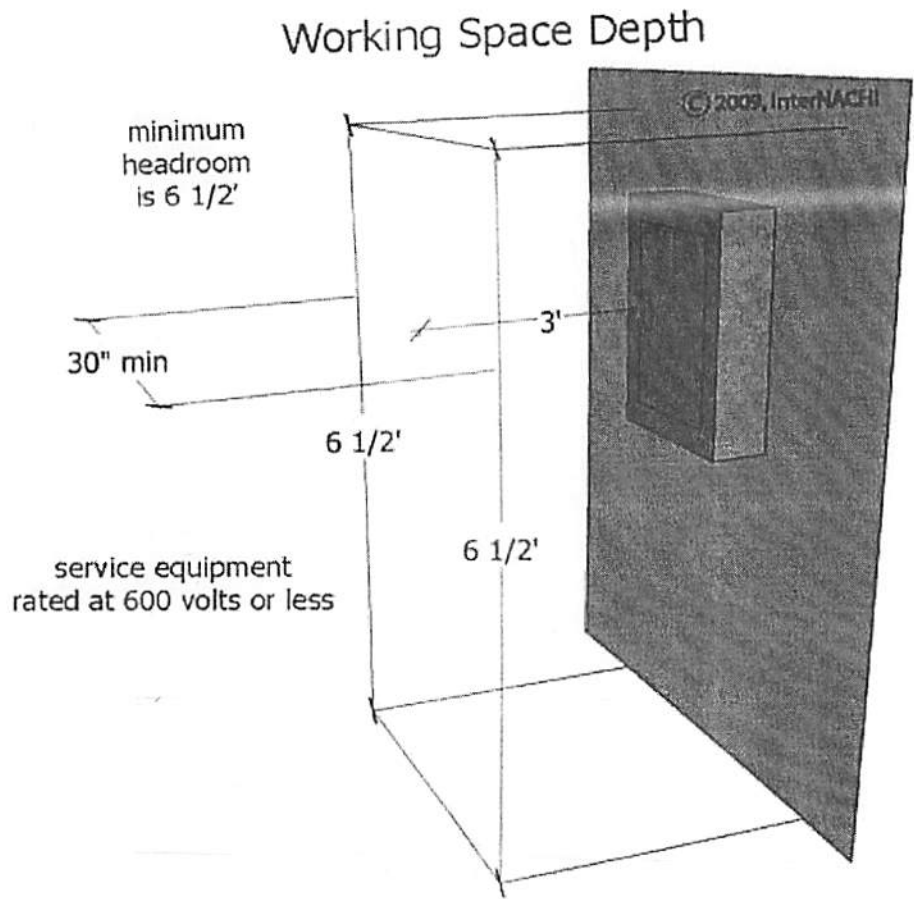

Minimum width of working space is the width of the equipment or 30 inches, whichever is greater.